

CURRENT

Ameresco Federal Solutions

Fort Irwin, CA
C&I – GSU
Crafted in Roanoke, VA

Base MVA – 15
Top MVA – 25
kV Rating – 33/12.47



Oncor

Backup transformer, TX
IOU – Power Distribution
Crafted in Pocatello, ID


Base MVA 28
Top MVA – 47
kV Rating – 138/26.4



CESS

Data Center, NV
Data Center – Power Distribution
Crafted in Rincon, GA

Base MVA – 35
Top MVA – 65.33
kV Rating – 230/12.47

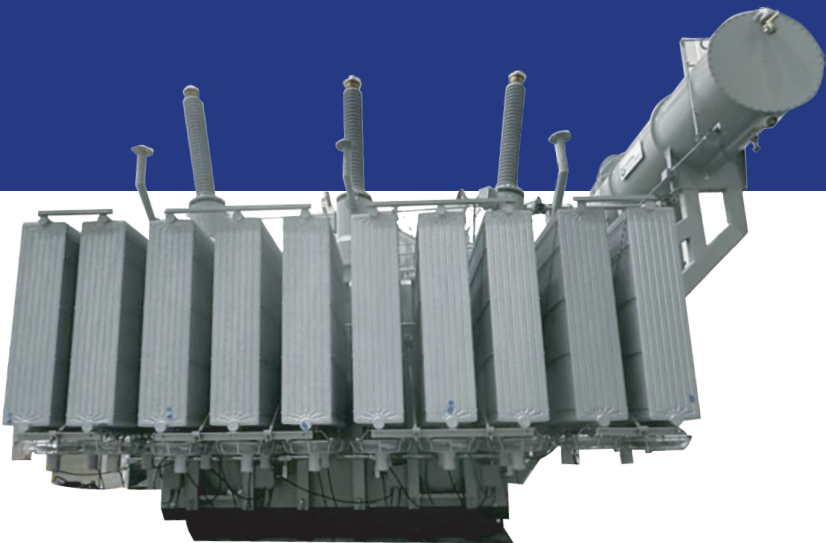

WESCO

Sisecam - Green River, WY
C&I – Motor Starting
Crafted in P1 - Chihuahua, MX



Base MVA 10
Top MVA – 14
kV Rating – 34.5/4.16

Whitewater

Rio Bravo Pipeline
Oil & Gas – Power Distribution
Crafted in P2 - Chihuahua, MX

Base MVA 3.25
Top MVA – 3.64
kV Rating – 12.47/0.48

