

Western Cooperative Electric Association
Coolyer Pumping Station, KS
PPU – Power Distribution
Crafted in Roanoke, VA

Base MVA – 10
Top MVA – 16.667
kV Rating – 115/13.2





Texas-New Mexico Power
Backup Transformer
IOU – Load Tap Changer
Crafted in Pocatello, ID

Base MVA 30
Top MVA – 50
kV Rating – 138/12.47



Consumers Energy
30 MW BESS Project, Oscoda, MI
BESS – Step Up
Crafted in Rincon, GA

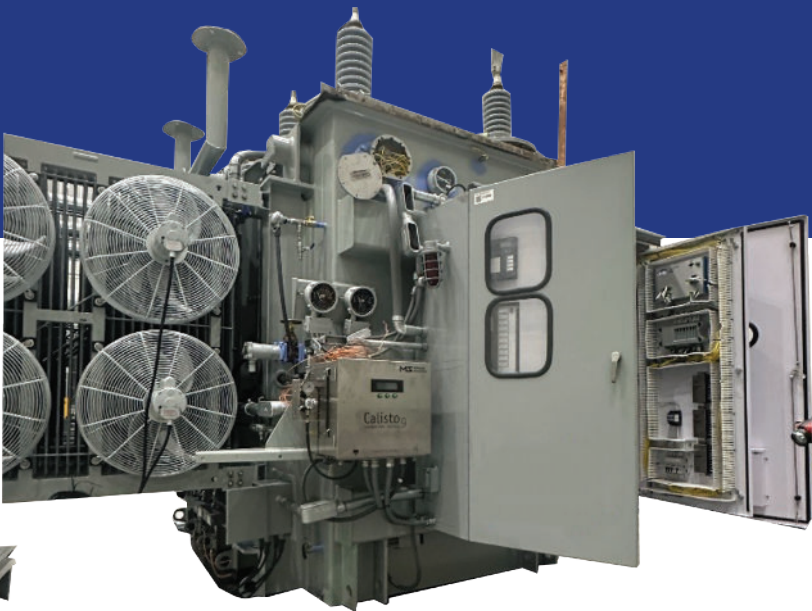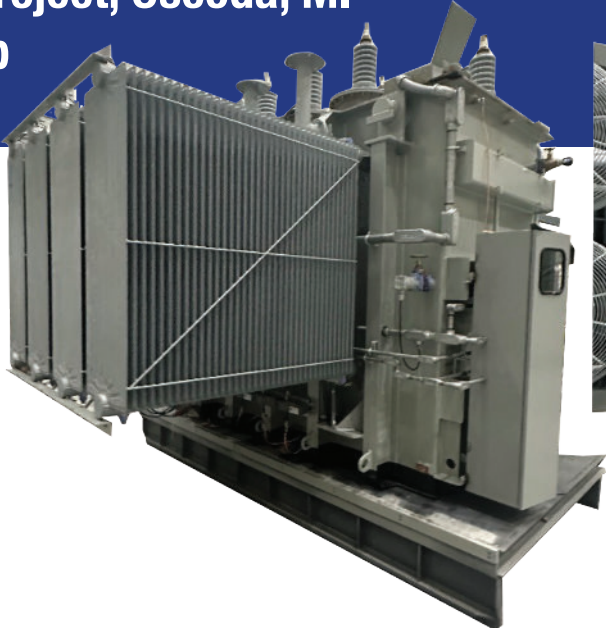

Base MVA – 23
Top MVA – 36
kV Rating – 46/34.5

Siemens
Chevron Offshore Oil Facility
Oil & Gas – Drive Duty
Crafted in P1 - Chihuahua, MX



Base MVA 5
Top MVA – 6.6
kV Rating – 24.4/5.3

Cloud HQ
LC11 Data Center, Ashburn, VA
E2X / Data Center – Power Distribution
Crafted in P2 - Chihuahua, MX



Base MVA 2.5
Top MVA – 3.5
kV Rating – 34.5/0.48